



*Dixit And Associates*

Architects  
Interior Designers

Ref D+A/AP/006/26-27

Date 05/01/2026

### CERTIFICATE

#### BACKUP ELECTRIC SUPPLY (DG SET)

This is to certify that I have inspected and verified the **backup electric supply arrangement** provided at **Shikshan Maharshi Dr. D. Y. Patil Centre for Management and Research**, located at **Gat No. 1029, 1030 & 1031, Newale Wasti, Chikhali, Pune – 411062**.

It is observed that the institution is provided with a **35 kVA, 3-Phase Diesel Generator Set** with acoustic enclosure, installed on a proper base frame with anti-vibration arrangements. The DG set is equipped with AMF control panel and necessary safety accessories and is **compliant with applicable CPCB norms**.

The DG set provides adequate and reliable **backup power supply** to meet the institutional requirements.

Based on the above, it is certified that the backup electric supply system is adequate, safe, and satisfactory.



Signature of Architect:

Mrs. Pooja Mahesh Dixit  
Registration No.: CA/2018/97695



### Backup Electric Supply – Diesel Generator Set

Shikshan Maharshi Dr. D. Y. Patil Center for Management and Research,  
Located at Gat No. 1029, 1030 & 1031,  
Newale Wasti, Chikhali,  
Pune – 412062

has purchased a 35 kVA Diesel Generating Set with the following specifications:

#### DG Set Specifications

- Capacity: 35 kVA, 3 Phase
- Engine Make: KOEL
- Engine Model: 3R1040T G1 (Green), Water-Cooled
- Power Output: 42 BHP @ 1500 RPM
- Alternator Make: KOEL Green
- Mounting: Mounted on a robust base frame

#### Accessories Supplied

- AMF – Auto Type Control Panel
- Fuel Tank
- Battery with Leads
- First Fill of Engine Oil
- Engine Safeties and Protections
- Anti-Vibration Mounting Pads
- Acoustic Enclosure suitable for 35 kVA DG Set
- Compliance with Latest CPCB Norms

#### Warranty Terms

The DG set is covered under warranty for 24 months or 5000 operating hours, whichever occurs earlier, from the date of commissioning.

The warranty is valid subject to:

- Use of Kirloskar K Oil Super
- Use of Kirloskar genuine filters
- Use of K-Cool Super Plus coolant
- Maintenance and services carried out exclusively through KOEL Authorized Service Dealers

This warranty shall be governed by the Kirloskar Oil Engines Limited Warranty Policy.





  
Director

**Dr. D. Y. Patil Centre For  
Management And Research**

Gat No.1029/1030, A/P, Chikhali 411062

Address : Gat No. 1029, 1030, Newale Wasti, Next To Thermax Square, Chikhali, Pimpri- Chinchwad, Pune- 411062  
Website : [www.dypatilmba.com](http://www.dypatilmba.com) | Email : [info@dypatilsantha.com](mailto:info@dypatilsantha.com), | Ph. : 020 27490299

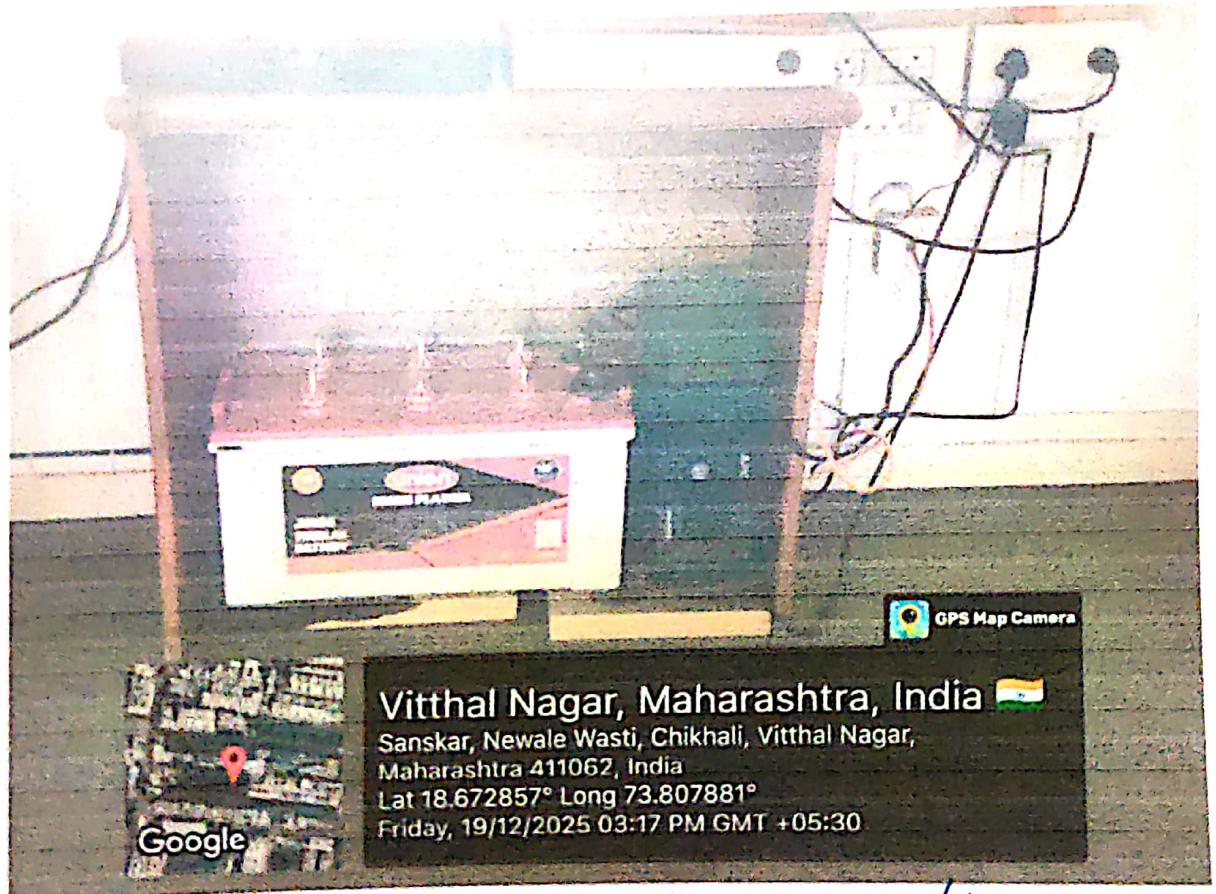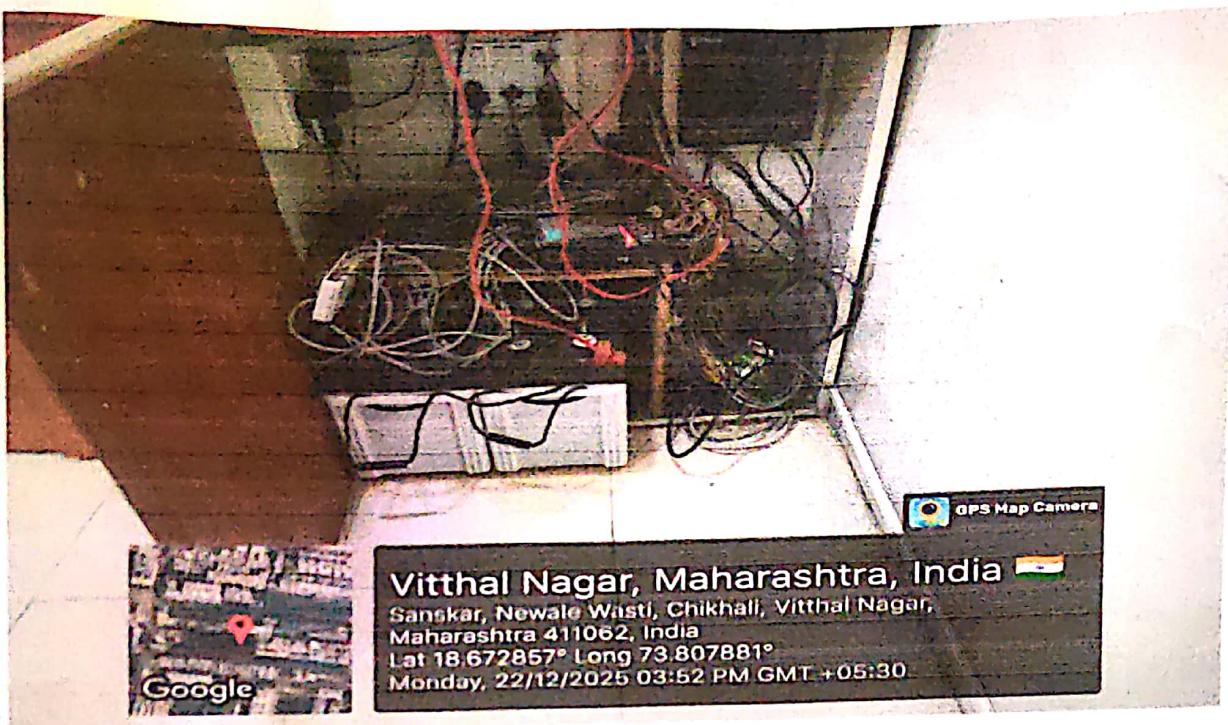

Director

Dr. D. Y. Patil Centre For  
Management And Research  
Gat No.1029/1030, A/P, Chikhali 411062